

# Transmission Planning in a Market Environment

Steven Stoft

updates available on  
www.stoft.com

Mexico City, May 30, 2002

## The Three Big Markets

- The Market for Energy (save a little soon)
- The Market for Generators (save a lot later)
- The Market for Transmission Lines (lose a little later)

“Deregulation,” if it works, will save a lot of money by building better generators in better places with better operation. (This takes decades.)

It will save a little money on better dispatch and more efficient end use.

It will waste a little money building extra wires to make the other two markets work better.

May 30, 2002

2

## Transmission (Tx) Investment is Difficult

- Generation has most of the qualities needed for a competitive market. **Transmission does not.**
- Integrated generation and transmission is relatively easy to regulate.
- The output of an integrated system is “delivered electricity.” We can measure that very accurately.
- The output of a transmission system is ... ????
- Transmission investment:
  1. Is very “lumpy.” (Efficient projects are huge.)
  2. Has strong externalities. (Interactions.)

May 30, 2002

3

## Three Approaches

- A **Non-Profit Transmission Administrator (TA)**  
Pro: No complex new regulatory problems.  
Con: Planning Tx is difficult without planning generation.
- A **For-Profit Transmission Company (Transco)**  
Pro: Might be able to harness profit motive.  
Con: Requires a new form of monopoly regulation.
- A **Transmission Market**  
Pro: Can utilize knowledge and motivation of generators.  
Con: Tx does not have the cost structure required for perfect competition. So far, such markets have not worked well.

May 30, 2002

4

## Theory of Optimal Transmission

- Build Tx to save generation costs.
- If a Tx upgrade saves more than it costs, Build it.
- If it saves less, Don't build it.
- One exception: It may be needed to reduce market power.

May 30, 2002

5


## The Units of Cost

- Say a transmission line costs  
 $\$100,000,000 + \$500,000 T$   
where  $T$  is the line capacity in MW.
- With a 10% cost of capital, the carrying cost is  
(  $\$10,000,000 + \$50,000 T$  ) per year
- Assuming (roughly) 10,000 hours / year, the carrying cost is  
(  $\$1000 + \$5 T$  ) per hour  
=  $\$1000/h + \$5/MWh$
- To understand the cost of a power line, think of renting one by the hour. To rent a 100 MW line there is a fixed cost of  $\$1000/h$  and a variable charge of  $\$5/MWh \times 100$  MW. (When planning, the line capacity is variable.)

May 30, 2002

6

## An Example

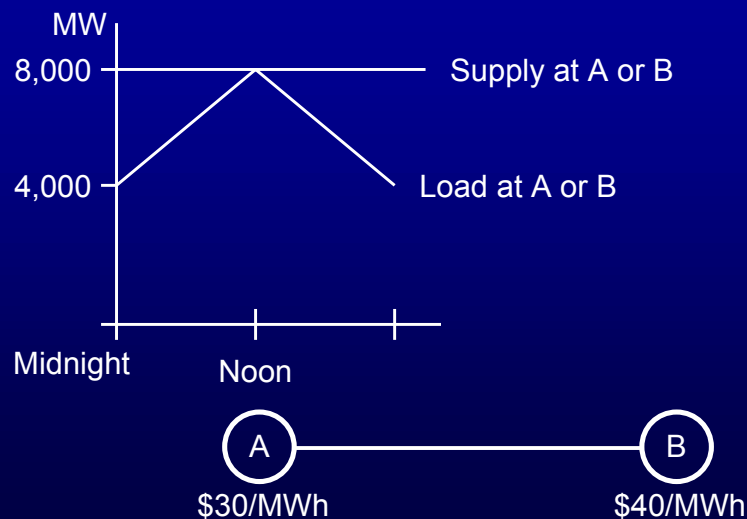

May 30, 2002

7

## Peak Load vs. Peak Use of Lines

- At midnight the total load is only 8,000 MW.
- There is 8,000 MW of cheap ( $\$30$ ) generation at A.
- At maximum load, there is no extra capacity at A or B and so no possibility of trade.
- **Maximum** line use occurs at **minimum** load.
- In the first year of PJM's market, there was never any congestion when the price was  $\$1000/MWh$ .

May 30, 2002

8


## Congestion

- If the line is smaller than 4,000 MW, then some cheap A-generators would like to sell to B at midnight, but cannot because the line is too small. This is congestion.
- **Congestion means: More trade is desired than can be supported by the lines.**
- Congestion does not mean: (1) a reliability problem, or (2) the lines are overloaded.
- If the line is 3,000 MW and the system operator tells 1,000 MW of A-generators not to run, this does not mean congestion has been eliminated !!! **There is still 1,000 MW of congestion.**

May 30, 2002

9

## An Simpler Example

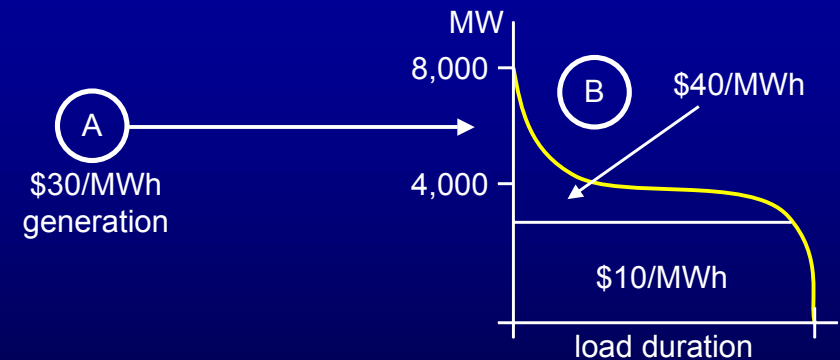

B has cheap base-load generation, but A is cheaper for mid and peak load.

May 30, 2002

10


## Optimal Line Capacity

- The marginal cost (rent) of the line is still \$5/MWh.
- The savings from using the line is \$10/MWh.
- If the last MW of line capacity is used half the time, the savings is \$5/MWh. This is the break-even point.
- If the line is used less, its cost is greater than its savings and it should not be built.
- Generation at B should only serve load with a duration of 50% or more.

May 30, 2002

11

## Optimal Line Capacity (#2)

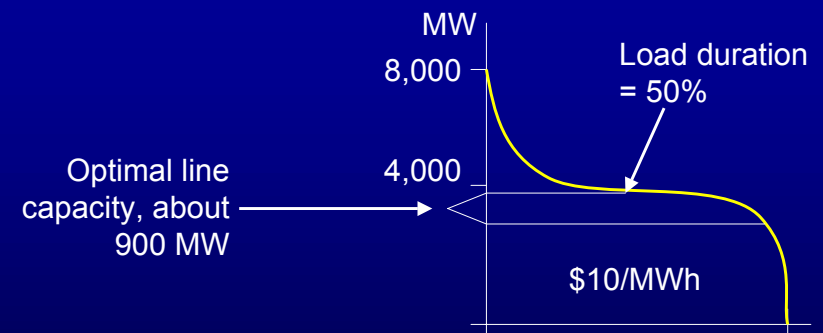

- Serving peak load over an expensive line wastes money because the line is used very little.
- To eliminate congestion, build another 4,100 MW of line.

May 30, 2002

12

## ***The Zero Congestion Approach***

- Alberta has a One-Price Pool.
- To help support this approach the for-profit Transco has proposed to build enough lines to eliminate all congestion.
- It has said it would build a \$500,000,000 line even if the price difference were just one penny !
- It estimates that this could double the cost of wires in Alberta.
- The Transco has just learned its contract will not be renewed.

May 30, 2002

13

## ***Politics***

- But NOT because of its bad economics.
- The Alberta government actually wants these wires built and is going to install a non-profit TA appointed by the government.
- They want to sell power from Northern Alberta to Los Angeles and make lots of money.
- Unfortunately, California already spent all of its money and bought very expensive power for the next 10 years. (It paid about \$13 billion too much.)

May 30, 2002

14

## ***Approach 1: (A Non-Profit TA)***

### **The Objective:**

- **Build the lines for a minimum-cost power system.**  
Minimize cost of Wires + Generators + Fuel
- **Congestion pricing (competitive locational pricing) will induce generators to locate efficiently.**
- **Building the right wires + competitive locational pricing is enough.**

May 30, 2002

15

## ***Approach 1: Paying for Lines***

- Since competitive locational prices are optimal, demand charges and peak-use charges reduce efficiency.
- The lines should be paid for with
  1. Congestion charges, plus
  2. A flat per-MWh charge to loads.
- Congestion charges are not enough. The remaining cost of wires must be paid for with a "tax."
- A flat per-MWh charge is the "tax" that causes the least distortion.
- Loads must pay all costs anyway.

May 30, 2002

16

## ***Approach 1: When to Build a New Line***

- Lines save different amounts at different times of the year.
- Compute the carrying cost of the new line for 1 year.
- Compute the energy-cost savings from having the line in place for each year.
- The line should go into service the first year it saves more than its carrying cost.

May 30, 2002

17

## ***Approach 1: How Big a Line to Build***

- This is the difficult planning problem.
- It requires predicting what generation the market will build.
- It requires comparing different possible lines over a long time horizon.

May 30, 2002

18

## ***Approach 2: A For-Profit Transco***

- A Transco is a monopoly and must be regulated.
- This approach has great potential.
- Some of the best economists are trying to solve the problem of how to regulate a Transco: Joskow, Tirole, Vogelsang, Wilson.
- So far they have not solved the problem, although they have many good (and complicated) ideas.
- When they do, it will take 30 years to explain it to FERC.
- Don't rush into this.

May 30, 2002

19

## ***Approach 2: A For-Profit Transco***

- If you want to try this approach, . . .
- If the Transco keeps the congestion rent, it will deliberately cause congestion.
- The congestion rent should be subtracted from the Transco's profit.
- One method of regulation is to pay a large annual sum (determined for many years at a time) and subtract from it the cost of losses and congestion.
- Wilson has some good ideas about reliability insurance and charging the transco for blackouts.

May 30, 2002

20

## Approach 3: A Market For Wires

- A generator that wishes to locate 100 km from the transmission grid should pay for its radial connection.
- That line is just like an extension of its power plant.
- Similarly, a generator that wishes to locate on a line that is fully utilized, should pay for the non-radial upgrade.
- This is not different from the radial-line case as long as this generator, and only this generator, gets to use the line.
- Transmission rights help turn non-radial upgrades into private property without causing market power.

May 30, 2002

21

## Two Main Problems with a Market for Wires

1. A generator may need only a 100 MW upgrade, when a 300 MW upgrade would be much cheaper per MW and useful to others. (Lumpiness)
2. If a generator builds a line the power of other generators may flow on it. (Externalities / Interactions)
  - These are basic problems with the cost-structure of the market.
  - Economics predicts a market with this cost structure will NOT be efficient.
  - Designing a successful transmission market requires fixing these structural problems.

May 30, 2002

22

## Solving the Cost-Structure Problems

- A transmission market needs a non-profit TA to solve these problems.
- The non-profit TA should
  1. Smooth out the lumpiness of costs.
  2. Provide a system of transmission rights.

May 30, 2002

23

## "Solving" the Lumpiness Problem

- Say a new generator needs a 100 MW upgrade to a shared radial line.
- Say a 100 MW upgrade costs \$50,000,000.
- Say a 200 MW upgrade costs \$60,000,000.
- Say the extra 100 MW will probably be needed soon.
- The non-profit TA should
  1. Build the 200 MW upgrade.
  2. Charge the generator \$30 million.
  3. Give that generator 100 MW of transmission rights.
  4. Withhold the extra 100 MW of line capacity until it can sell it for \$30 million to the next generator.

May 30, 2002

24

## Transmission Rights Help with Externalities

- **Physical** transmission rights are very complicated.
- **Financial** transmission rights are simpler and are well defined.
- A typical financial transmission right (FTR) from A to B, pays the congestion charge from A to B.
- If the price is \$10 at A and \$25 at B, a 100 MW FTR from A to B pays \$1500/h.
- It pays this whether or not you send any power.
- This gives you the right to transmit at no cost, or you can sell it and make money when you do not need it.

May 30, 2002

25

## Rewarding Investment with FTRs

- There is a well-known rule: **The Feasibility Rule**.
- Think of FTRs as power flows.
- The set of all FTRs must be feasible (a safe flow of power).
- A transmission upgrade allows more power to flow, so more FTRs are feasible.
- Someone who pays for a Tx upgrade should be given FTRs for the increase in feasible flows.
- This guarantees they can use their own upgrade at no cost.

May 30, 2002

26

## Approach 1: A Non-Profit TA

- The TA works beside the ISO under the energy minister. The ISO handles the short run, and the TA handles the long run.
- **Goals:**
  1. Minimize cost of Wires + generators + fuel.
  2. Collect cost of wires and avoid distorting the dispatch.
  3. Maximize competition.
- **Do Not attempt to reduce the average retail price except by 1 & 2 above.**  
(Any other method is an exercise of monopsony power and will cause inefficiency and higher prices in the long run.)

May 30, 2002

27

## Approach 1: A Non-Profit TA (#2)

- Build extra lines for competition (How many ??).
- A "load pocket" is a where all incoming lines become congested.
- Generation in the load pocket has no competition from the outside.
- Transmission is a very effective way to reduce market power in a load pocket, but . . .
- A little extra transmission is cheap because it saves energy costs. A lot extra can be very expensive.

May 30, 2002

28

## **Approach 3: A Transmission Market**

---

- **An Non-Profit TA is still needed just as in Approach 1.**
- **The TA would still handle reliability upgrades.**
- **The TA would**
  1. approve commercial upgrades.
  2. give out transmission rights.
  3. solve the lumpiness problem.
- **The goals would be the same as Approach 1, but instead of always computing the least-cost lines, the TA would often let the market choose them.**

May 30, 2002

29

## **Recommendations**

---

- **Start with Approach 1 (non-profit TA)**
- **Slowly add Approach 3 (include more of a market).**

(If you have a One-Price Pool, you need Approach 3 and physical rights. So don't use a One-Price Pool).
- **Wait until the wholesale power market is working well before experimenting with Approach 3.**
- **The NY-ISO has been trying Approach 3 but without solving the lumpiness problem. In three years, one transformer has been added and one DC line has been started. We do not know if this market will work.**

May 30, 2002

30

---

# **The End**

May 30, 2002

31